


PLAN

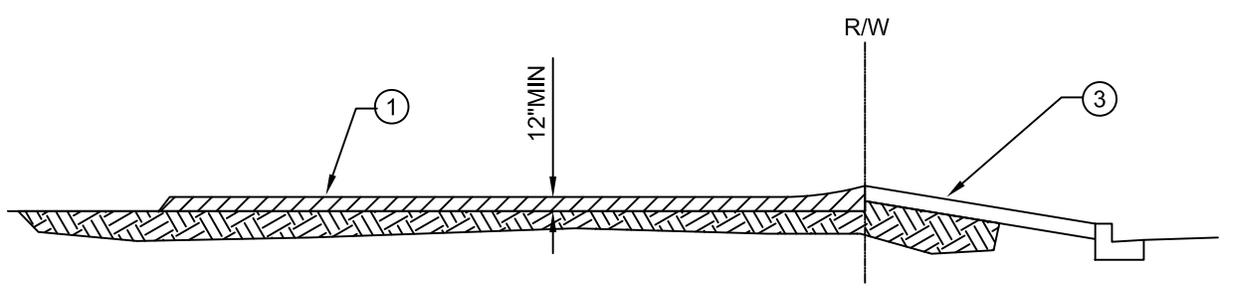

SECTION

**NOTES:**

- ① QUARRY SPALLS 4" - 8", CRUSHED CONCRETE 4" - 8", OR HOG FUEL.
- ② SEE FIGURE 4.2 IN THE 2005 STORMWATER MANAGEMENT MANUAL FOR WESTERN WASHINGTON FOR DETAILS. NOTE: THE MINIMUM 100LF OF ENTRANCE SHALL BE REDUCED TO THE MAXIMUM PRACTICABLE SIZE WHEN THEN SIZE OR CONFIGURATION OF THE SITE DOES NOT ALLOW THE FULL LENGTH (100LF).
- ③ EXISTING DRIVEWAY RAMP, OR SITE ACCESS ROAD 20' WIDE MIN. MATERIAL MUST BE EQUAL TO OR BETTER THAN SPECIFIED IN NOTE 1.
- ④ A SEPARATION GEOTEXTILE SHALL BE PLACED UNDER THE SPALLS TO PREVENT FINE SEDIMENT FROM PUMPING UP INTO THE ROCK PAD. THE GEOTEXTILE SHALL MEET THE FOLLOWING STANDARDS:  
 GRAB TENSILE STRENGTH (ASTM D4751)      200 PSI MIN.  
 GRAB TENSILE ELONGATION (ASTM D4632)      30% MAX.  
 MULLEN BURST STRENGTH (ASTM D3786-80A)      400 PSI MIN.  
 AOS (ASTM D4751)      20-45 (U.S. STANDARD SIEVE SIZE)



TEMPORARY CONSTRUCTION  
ENTRANCE

DRAWING NUMBER	STD2-9
SCALE	NONE
REVISION DATE	06/15
DEPARTMENT	PW