




FRAME STD 4-5  
 SLOTTED GRATE PER STD 4-6  
 VANED GRATE PER STD 4-8  
 OPEN CURB FACE PER STD 4-11

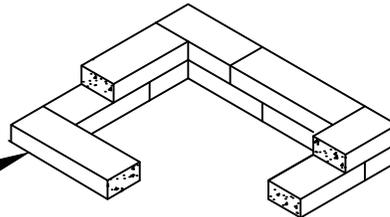

2"x4"x8" SOLID BRICK  
 USED FOR FINAL ADJUSTMENT  
 TO GRADE. 6" HIGH MAX

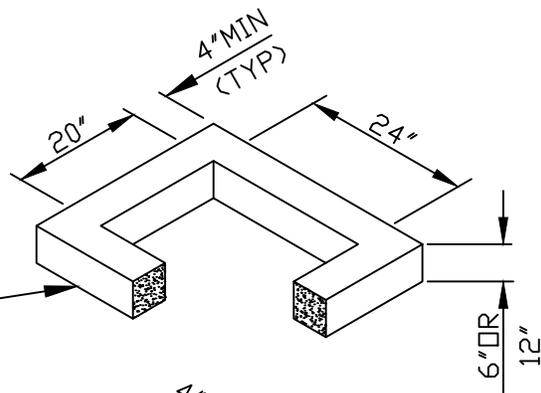

2", 4", 6" OR 12" CONCRETE  
 RISER SECTION  
 CLASS 4000 CONC

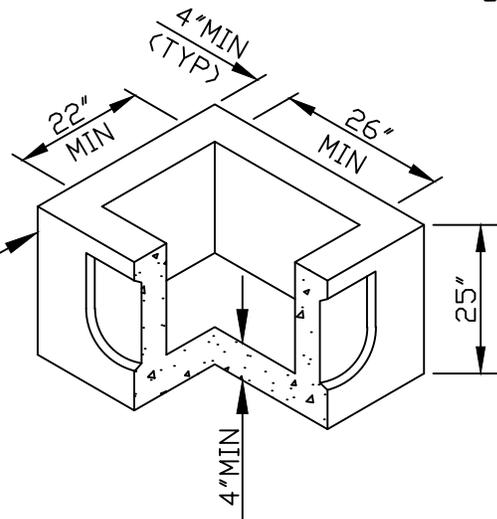

PRECAST CONC BASE SECTION  
 W/MAX OF ONE 17"Ø KNOCKOUT  
 PER SIDE. ENTRANCE ANGLE  
 TO BE LIMITED BY KNOCKOUTS  
 CLASS 4000 CONC  
 PIPE OUTER DIA PLUS  
 INLET WALL THICKNESS  
 SHALL NOT EXCEED 17".

PIPES SHALL NOT PENETRATE MORE THAN 3", AND PIPES  
 SHALL BE MUDDERED INTO A SMOOTH ROUNDED CONDITION.



PRECAST CONCRETE INLET

I:\Standard\_Plans

DRAWING NUMBER	STD 4-1
SCALE	NONE
REVISION DATE	08/03
DEPARTMENT	PW