



PLAN

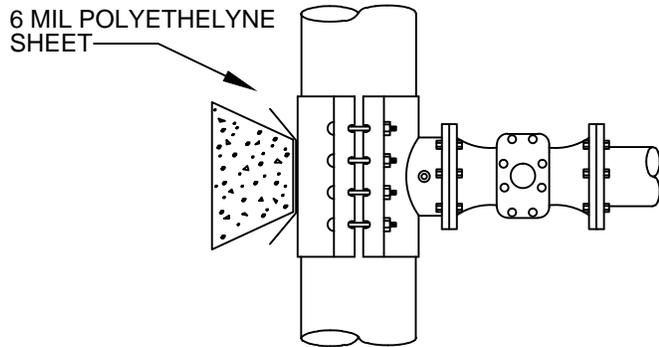

PLAN

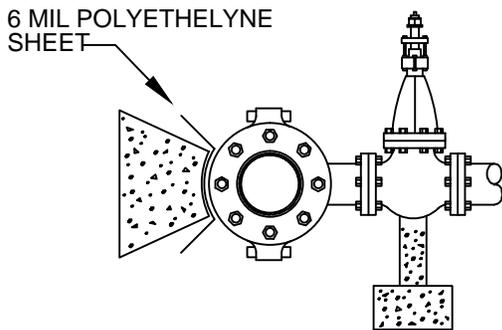

ELEVATION

INSTALLED ON ASBESTOS CEMENT PIPE,
CAST IRON PIPE AND DUCTILE IRON
PIPE.


STEEL TAPPING TEE

INSTALLED ON DUCTILE IRON PIPE
ONLY.

CAST IRON TAPPING TEE
MECHANICAL JOINT SLEEVE

NOTES:

1. STAINLESS STEEL TAPPING TEES SHALL HAVE FULL CIRCLE SEAL.
2. STEEL TAPPING TEES SHALL BE EPOXY COATED.
3. ALL TEES AND VALVES TO BE WATER TESTED BEFORE TAP.

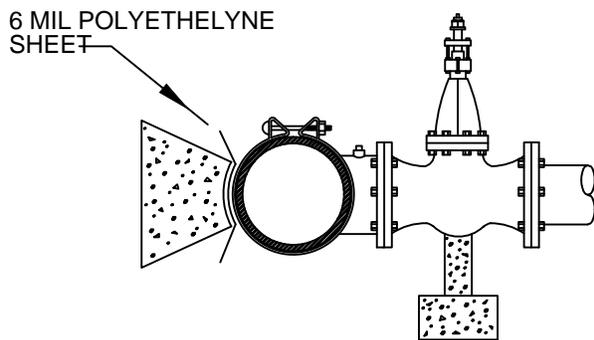

ELEVATION

STAINLESS STEEL TAPPING TEE

INSTALLED ON ASBESTOS CEMENT PIPE,
CAST IRON PIPE AND DUCTILE IRON
PIPE.

STAINLESS STEEL OR STEEL
TAPPING TEE

DRAWING NUMBER	STD5-11
SCALE	NONE
REVISION DATE	11/01
DEPARTMENT	PW