



PLAN

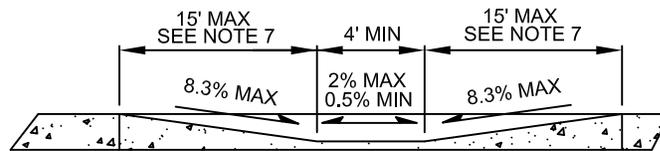

SECTION A-A

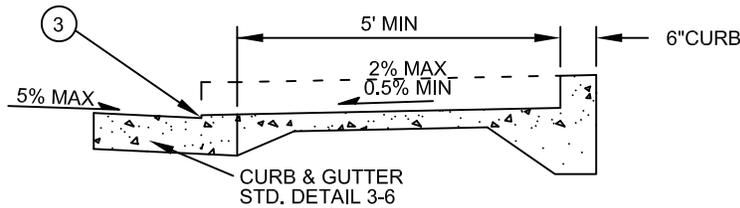

SECTION B-B

NOTES

- ① RAMP TEXTURING SHALL BE A BROOM FINISH PERPENDICULAR TO THE DIRECTION OF TRAVEL.
- ② FULL DEPTH EXPANSION JOINT.
- ③ NO LIP AT GUTTER LINE.
- ④ CURB RAMPS WILL NOT BE POURED INTEGRAL WITH SIDEWALK AND SHALL BE ISOLATED BY EXPANSION JOINT MATERIAL ON ALL SIDES.
- ⑤ TRUNCATED DOME PER ADA STANDARDS. TRUNCATED DOMES SHALL BE NON-CONCRETE, POLYMER, COMPOSITE, CAST IN PLACE UNITS COMPLIANT WITH ADA STANDARDS. COLOR SHALL BE UNIFORMLY INTEGRAL THROUGHOUT THE CROSS SECTION AND CONTRASTING COLOR WITH ADJACENT WALKWAY SURFACES PER ADA STANDARDS. SUBMIT SAMPLE TO CITY FOR APPROVAL PRIOR TO INSTALLATION.
- ⑥ POUR CURB SEPARATE FROM SIDEWALK POUR.
- ⑦ RAMP LENGTH VARIES WITH A MINIMUM OF 6' AND SHALL BE CALCULATED BASED ON A RAMP SLOPE WHICH DOES NOT EXCEED 8.3%. THE CURB RAMP MAX SLOPE SHALL NOT REQUIRE THE RAMP LENGTH TO EXCEED 15 FEET TO AVOID CHASING THE SLOPE INDEFINITELY WHEN CONNECTING TO STEEP GRADES. WHEN APPLYING THE 15 FOOT MAXIMUM LENGTH, THE RUNNING SLOPE OF THE CURB RAMP SHALL BE AS FLAT AS FEASIBLE.

DRAWING NUMBER	STD3-15
SCALE	NONE
REVISION DATE	03/14
DEPARTMENT	PW