


1. ORIENTATION LOCATIONS (FROM EDGE OF WALKWAY OR FACE OF CURB):
 - HANDHOLE ACCESS DOOR SHALL BE MOUNTED AT 90°
 - RECEPTACLE SHALL BE MOUNTED AT 90°, SEE STD. CC-ILL-9.
2. NEW AND EXISTING UTILITIES MUST BE SHOWN ON DEVELOPMENT PLANS WITH APPROPRIATE CLEARANCES. ANY FIELD ADJUSTMENTS MUST BE APPROVED BY RESPECTIVE UTILITY OWNERS.
3. FOR ADDITIONAL INFORMATION ON MIN. CLEARANCES REFER TO LYNNWOOD STANDARD PLANS TR-ILL-3 AND SNOHOMISH COUNTY PUD NO. 1 ELECTRICAL SERVICE REQUIREMENTS SECTIONS 3, 4, & 5.
4. FOR ADDITIONAL INSTALLATION DETAILS REFER TO LYNNWOOD STANDARD PLANS TR-ILL-1 AND TR-ILL-2.

5. LUMINAIRE MANUFACTURER: ARCHITECTURAL LIGHTING - SPECTRA (LARGE).
6. POLE: 5" DIA STRAIGHT ALUMINUM, POST TOP MOUNT, METALLIC POLYESTER POWDER COAT - GRAPHITE GRAY (COLOR CODE RAL 7024).
7. BASE: 2'-8" TALL X 5" DIA, CLEAR ANODIZED ALUMINUM.
8. BANNER AND FLOWER BASKET ARMS AND ATTACHMENTS PER MANUFACTURER.
9. LUMINAIRE: ALUMINUM HOUSING WITH QUICK INSTALLATION SYSTEM (QIS), CLEAR CYLINDER LUMINAIRE HOUSING WITH ROUND COPPER ANGLE HOOD.
LED 400K LAMP (NEUTRAL WHITE)
10. ELECTRIC SERVICE, METER, AND CONDUCTORS PER APPROVED PLANS.

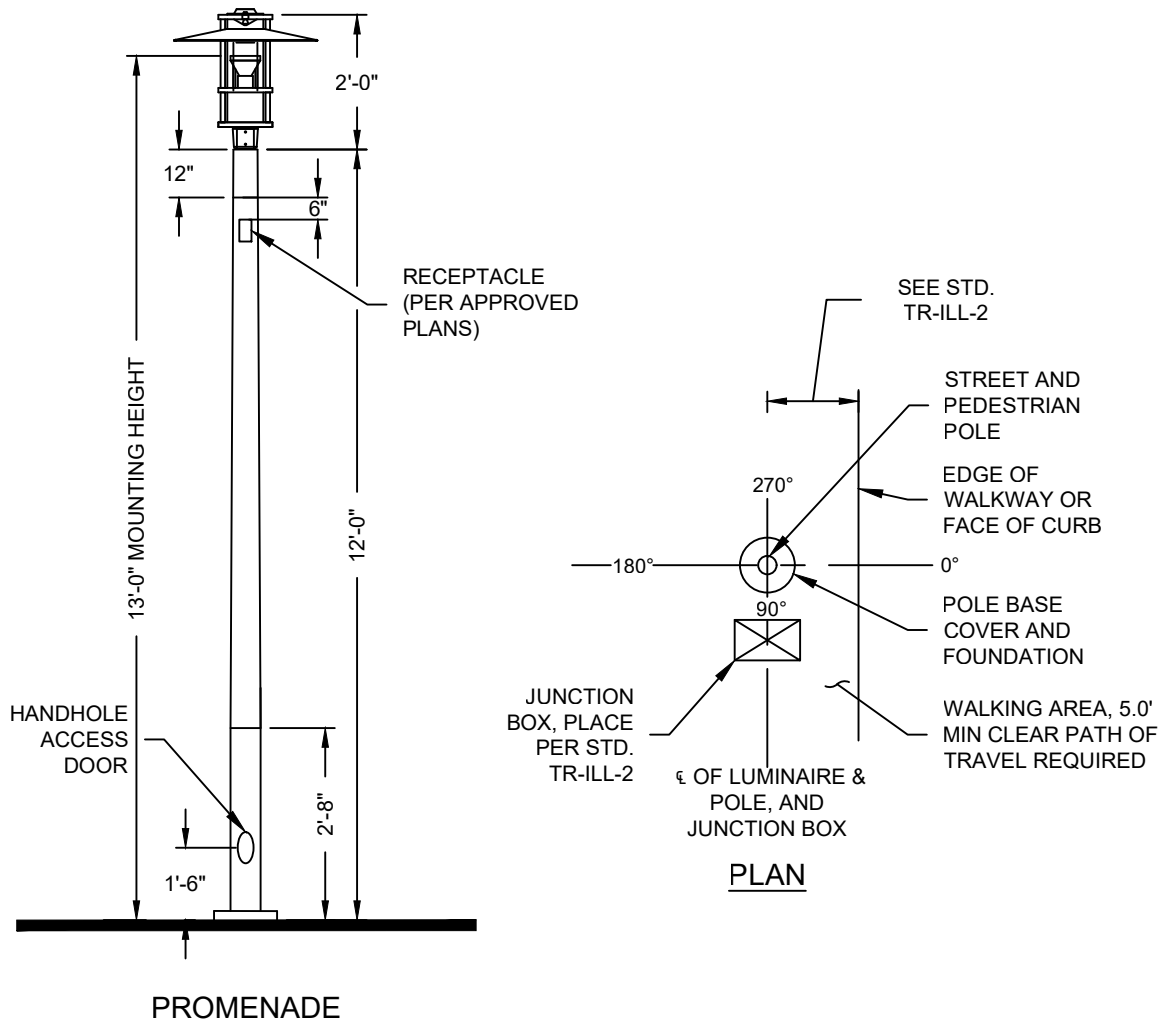

CITY CENTER
PROMENADE: PEDESTRIAN
LUMINAIRE & POLE

CC-ILL-4-City-Center-Promenade-Pedestrian-Luminaire-&-Pole.dwg

DRAWING NUMBER	CC-ILL-4
SCALE	NONE
REVISION DATE	03/22
DEPARTMENT	PW