


℄ OF BOLLARD

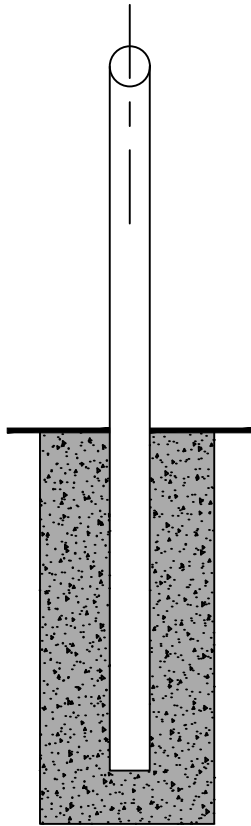

SECTION

NOTES:

1. HEAVY DUTY SECURITY BOLLARD SHALL BE "ANTI RAM STAINLESS STEEL" BOLLARDS OR APPROVED EQUAL.
2. FINISH SHALL BE HORIZONTAL BRUSH, STAINLESS STEEL WITH ANTI-GRAFFITI COATING.
3. FOOTING SHALL BE PLUMB AND INSTALLED PER MANUFACTURER'S RECOMMENDATIONS.
4. APPLIES TO CELEBRATORY CORNERS AND ANY LOCATION DEEMED NECESSARY BY THE CITY ENGINEER.

5' EMBEDMENT

5'-6" FTG
DEPTH

(6) #4 VERTS
EQUALLY
SPACED

2'-6" SQUARE OR
LARGER TO
MATCH SCORING

$\frac{3}{4}$ " \varnothing x 4" STUDS, TYP.
OF 4, 2 TOP AND 2
BOTTOM OF POST AT
A 90° OFFSET.

#4 HOOPS @ 12" O.C.

2" MIN. CLR

FOOTING

EXPANSION
JOINT,
TYP. (SEE
CC-SID-6)

4.0' MIN.

℄ OF
BOLLARD

SCORE
JOINT, TYP.
(SEE STD
CC-SID-6)


3'-0"

FACE OF
CURB
BOLLARD @
5' O.C.
SPACING

CEMENT
CONCRETE
CURB

SCORED
CEMENT
CONCRETE
SIDEWALK

PLAN

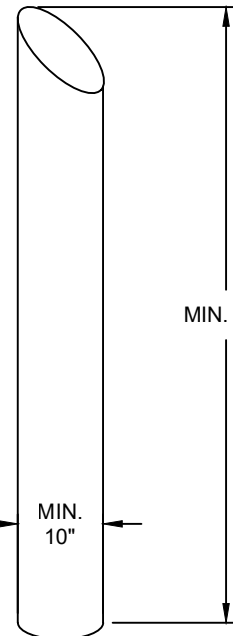

MIN. 2.5'

MIN.
10"

AXONOMETRIC