


EXTRUDED CEMENT CONCRETE CURB

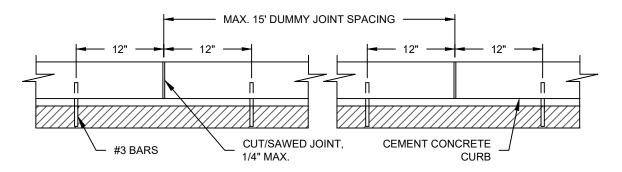

SPACING OF ANCHOR BARS

NOTES:

- 1. CUT JOINTS SHALL BE PLACED ONLY AT POINTS OF TANGENCY ON STREET ALLEY AND DRIVEWAY RETURNS AND WHERE EXPANSION JOINTS OCCUR IN THE PAVEMENT SLAB.
- 2. FINISHING, CURING, FORM WORK, PLACEMENT AND MATERIALS SHALL CONFORM TO THE CURRENT WSDOT SPECS.
- 3. AT THE CONTRACTOR'S OPTION CONCRETE CURBS MAY BE ANCHORED TO THE EXISTING PAVEMENT EITHER BY PLACING STEEL TIE BARS 1 FOOT ON EACH SIDE OF EVERY JOINT, OR BY USING AN ADHESIVE. THE ADHESIVE SHALL MEET THE REQUIREMENTS OF SECTION 9-26 OF THE WSDOT/APWA STANDARD SPECIFICATIONS FOR TYPE II EPOXY RESIN.



CONCRETE EXTRUDED CURB

DRAWING NUMBER	ST-CG-3
SCALE	NONE
REVISION DATE	12/20
DEPARTMENT	PW

ST-CG-3-Concrete-Extruded-Curb.dw